

ASSEMBLY AREAS

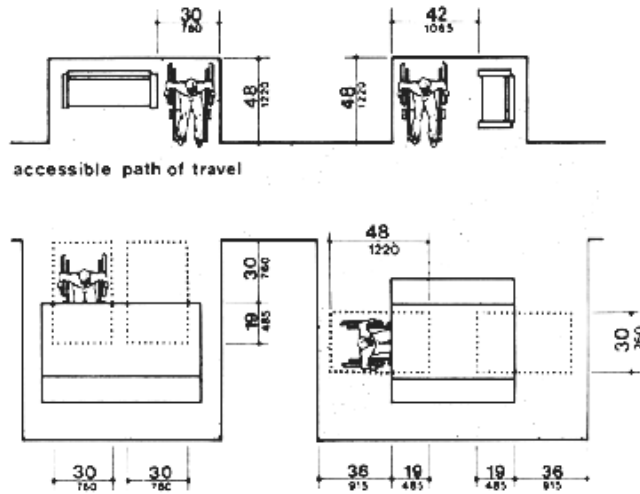


Fig. 45
 Minimum Clearances for Seating and Tables

Figure 45 (4.32.3)

Minimum Clearances for Seats and Tables

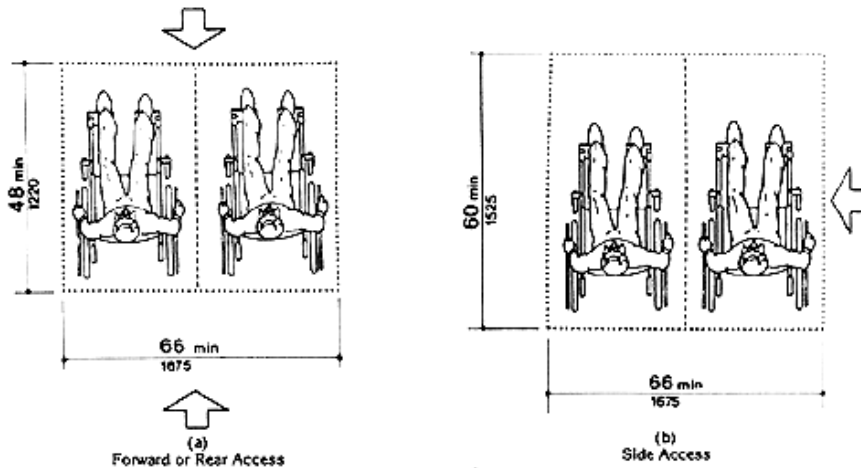


Figure 46 (4.33.2)

Space Requirements for Wheelchair Seating Spaces in Series

Capacity of Seating in Assembly Areas	# of Required Wheelchair Locations
4 to 25	1
26 to 50	2
51 to 300	4
301 to 500	6
Over 500	6 plus 1 additional space for each total seating capacity increase of 100

TABLE OF REQUIRED SEATING CAPACITIES (4.1.3)